

3-

«

»

«

»

...

...

, 27

2015

«

»,

«

»

:


—

(B)

,

(A)

(C)




—

(B)

,

(A)

(A),





( 500 , )

1000

0,5

/



,

1,2

/

"KEGOC",

,

,



.

.

,



.

( )


500


,

.

,

# Карта-схема основных эл.сетей 220 - 500 кВ ОЭС Центральной Азии с перспективой до 2020 г.

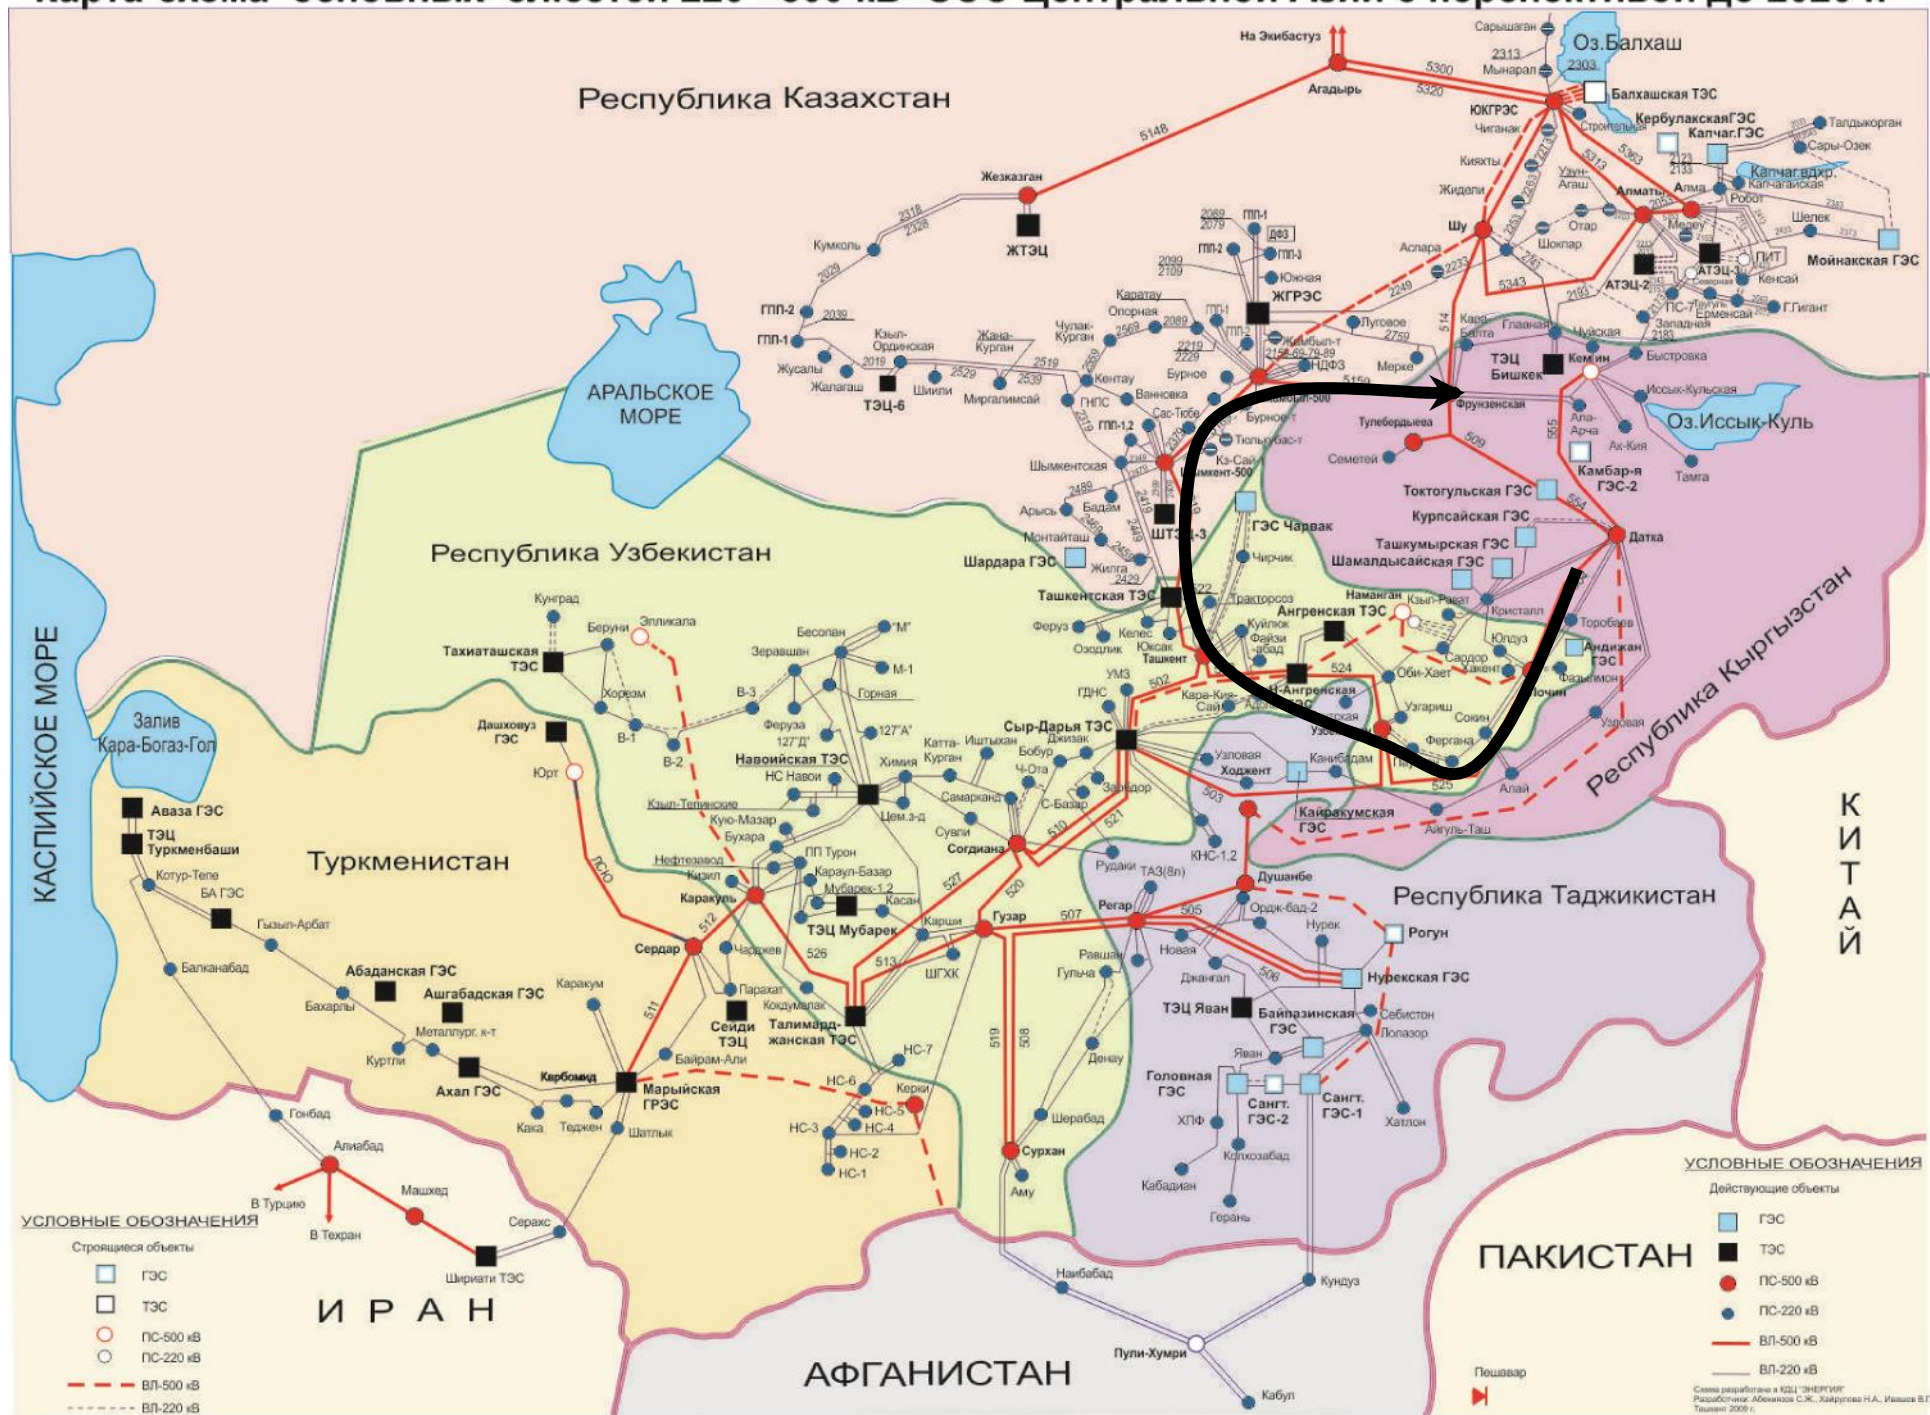

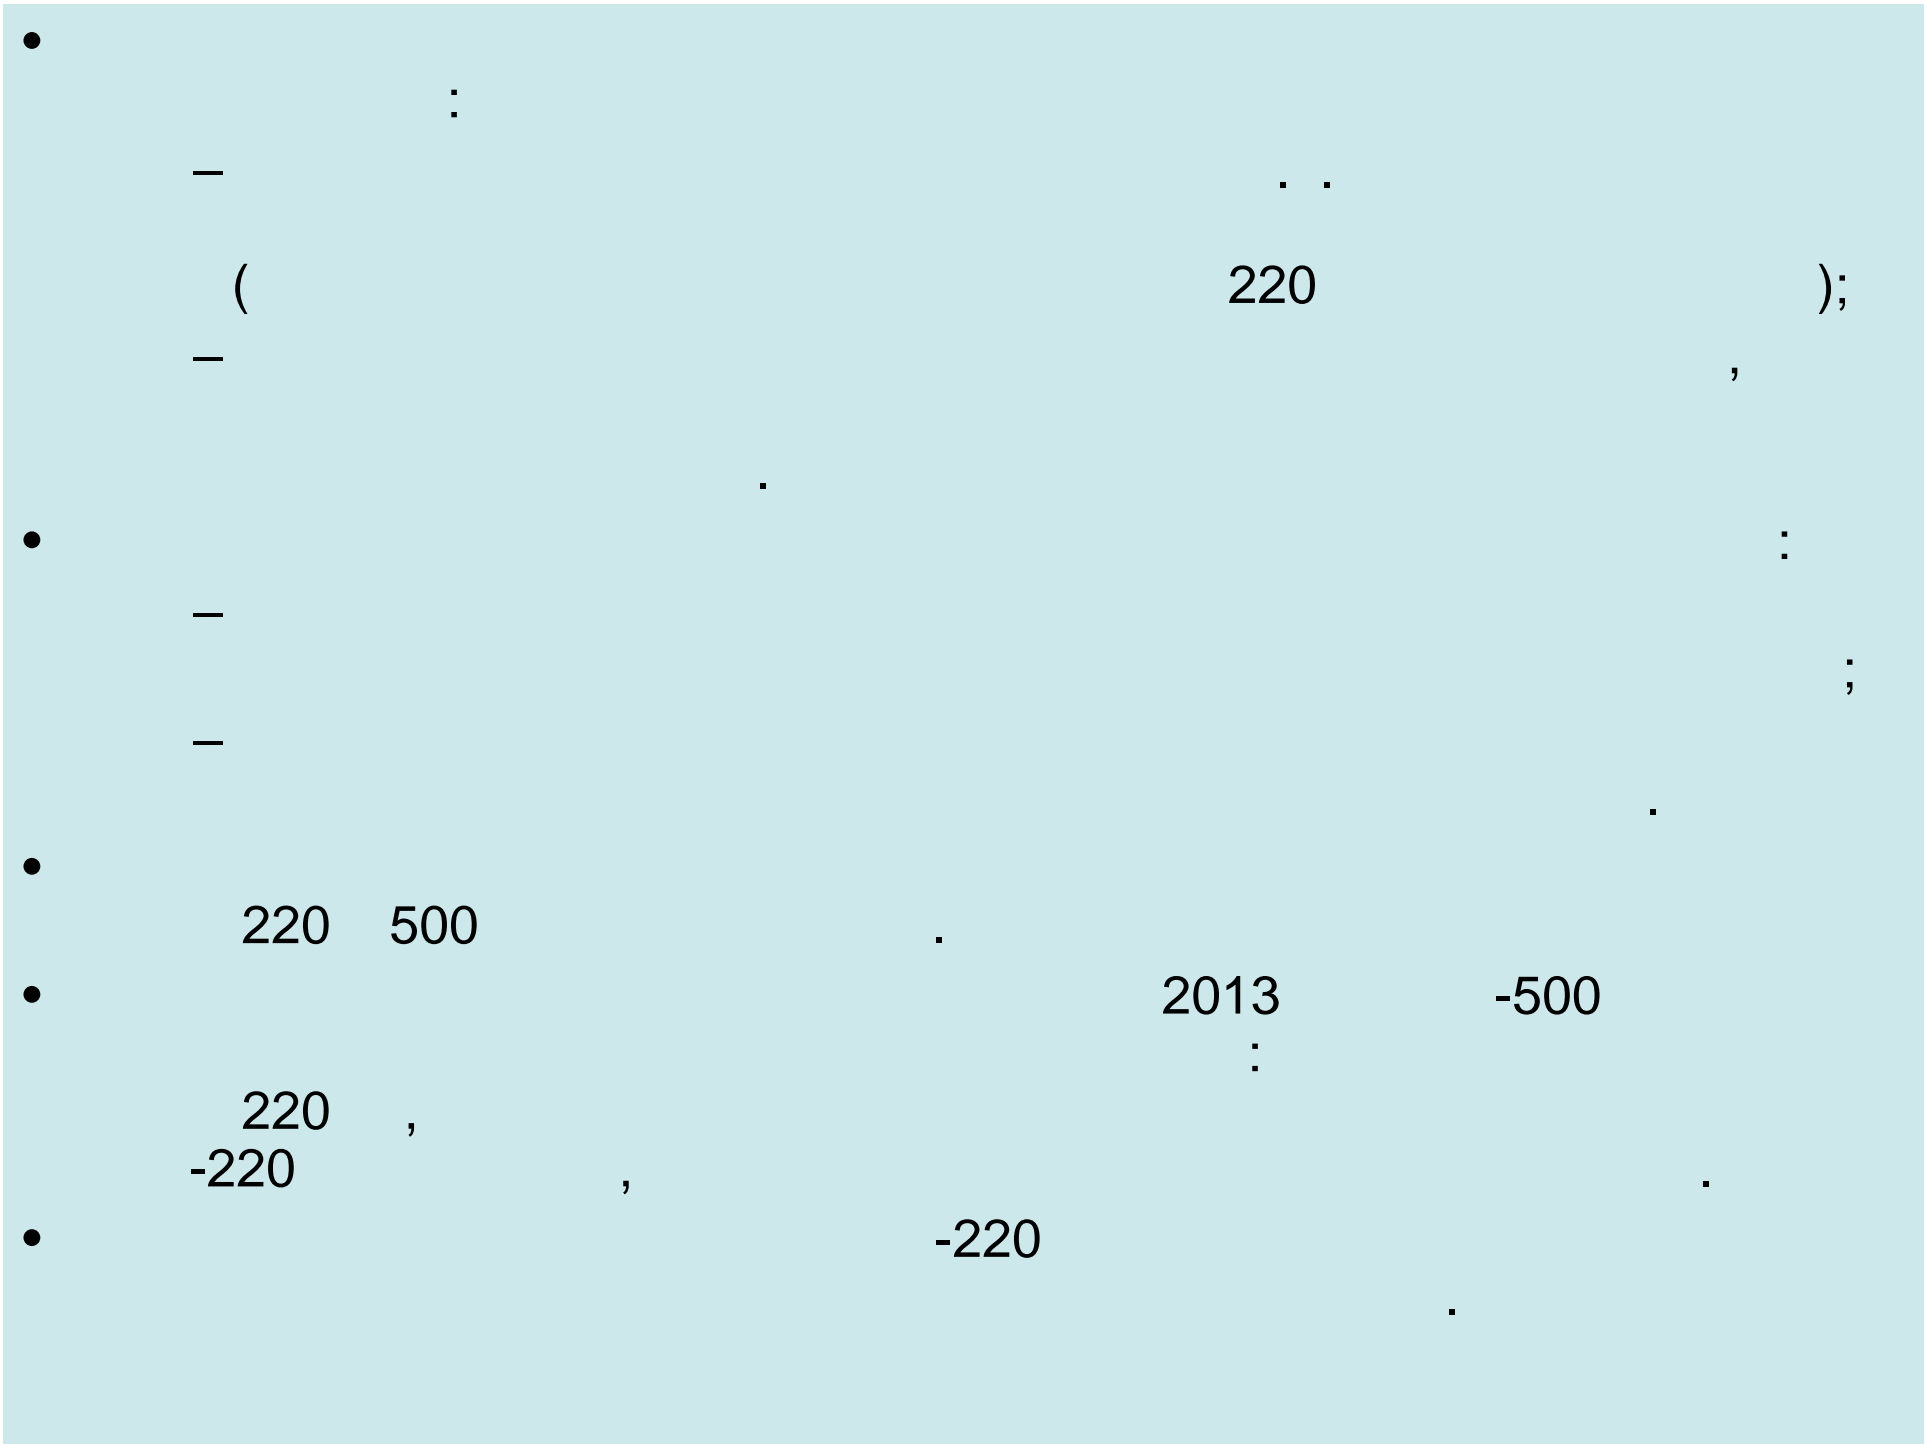


2015

-500

220

220

-220

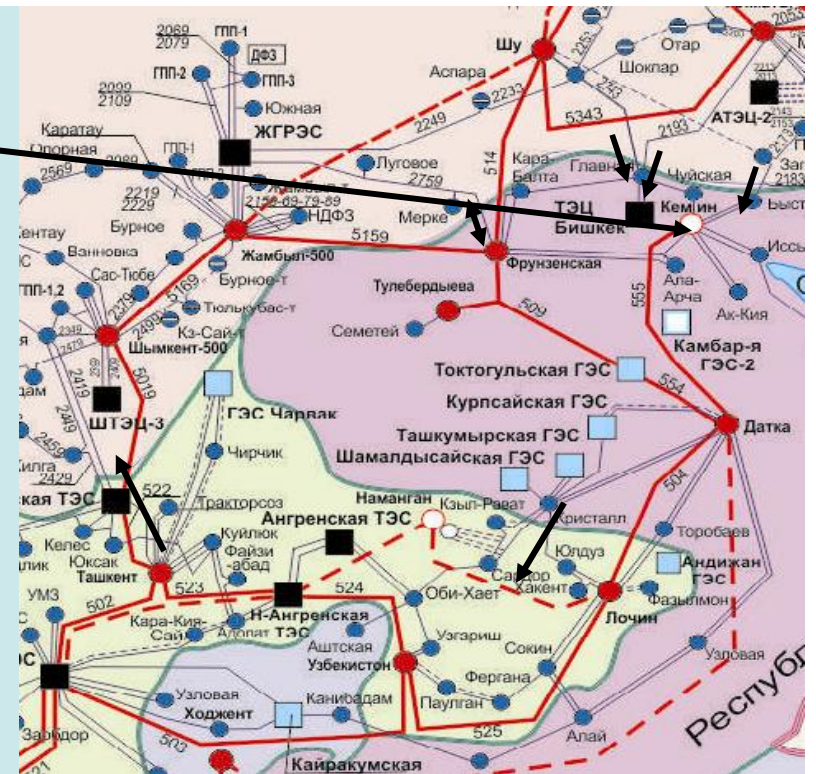

220

•

-500 ;

•

500

500

•

;

,

,

,

,

-

,

);

,

•

(

500 ),

(

.

.

ETSO (

).

INO GATE

ETSO ITC-

.

ITC- (inter-TSO compensation for transit) :

- ITC-

(FF),  
(  
100 . )

- ( . . « » )  
(

- .


:  $TF = T_i / T_i$

- (+) (-)

- .

( . . WWT – with & without transit).




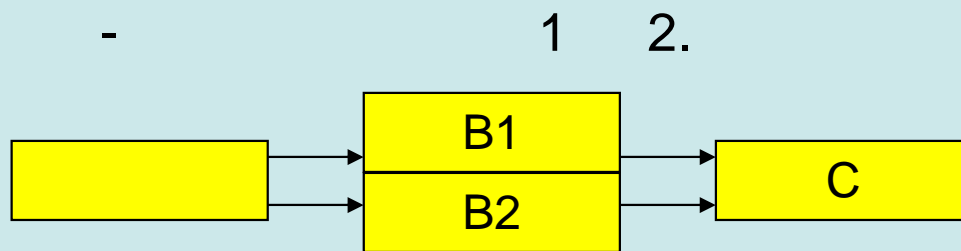


ETSO

$$T_{in} = \min (NEF, NIF),$$

NEF –  
NIF –




(Ti)

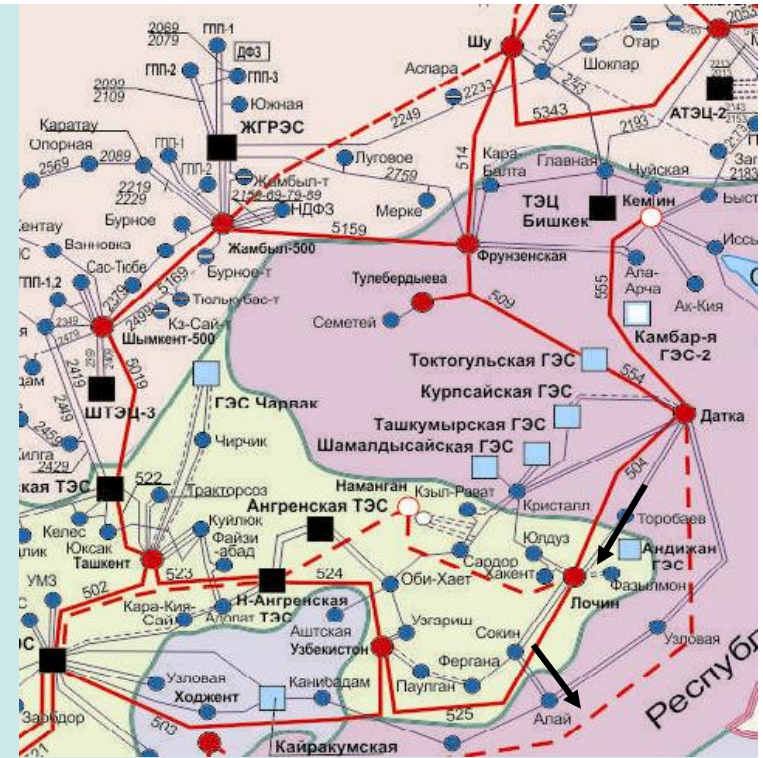


$$T_{out} = NEF + NIF$$

$$T_{out} = \max(NEF, NIF)$$

ITC-

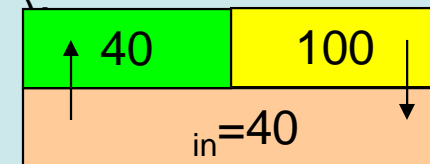

$$T_{out} = 100 \text{ MW}$$

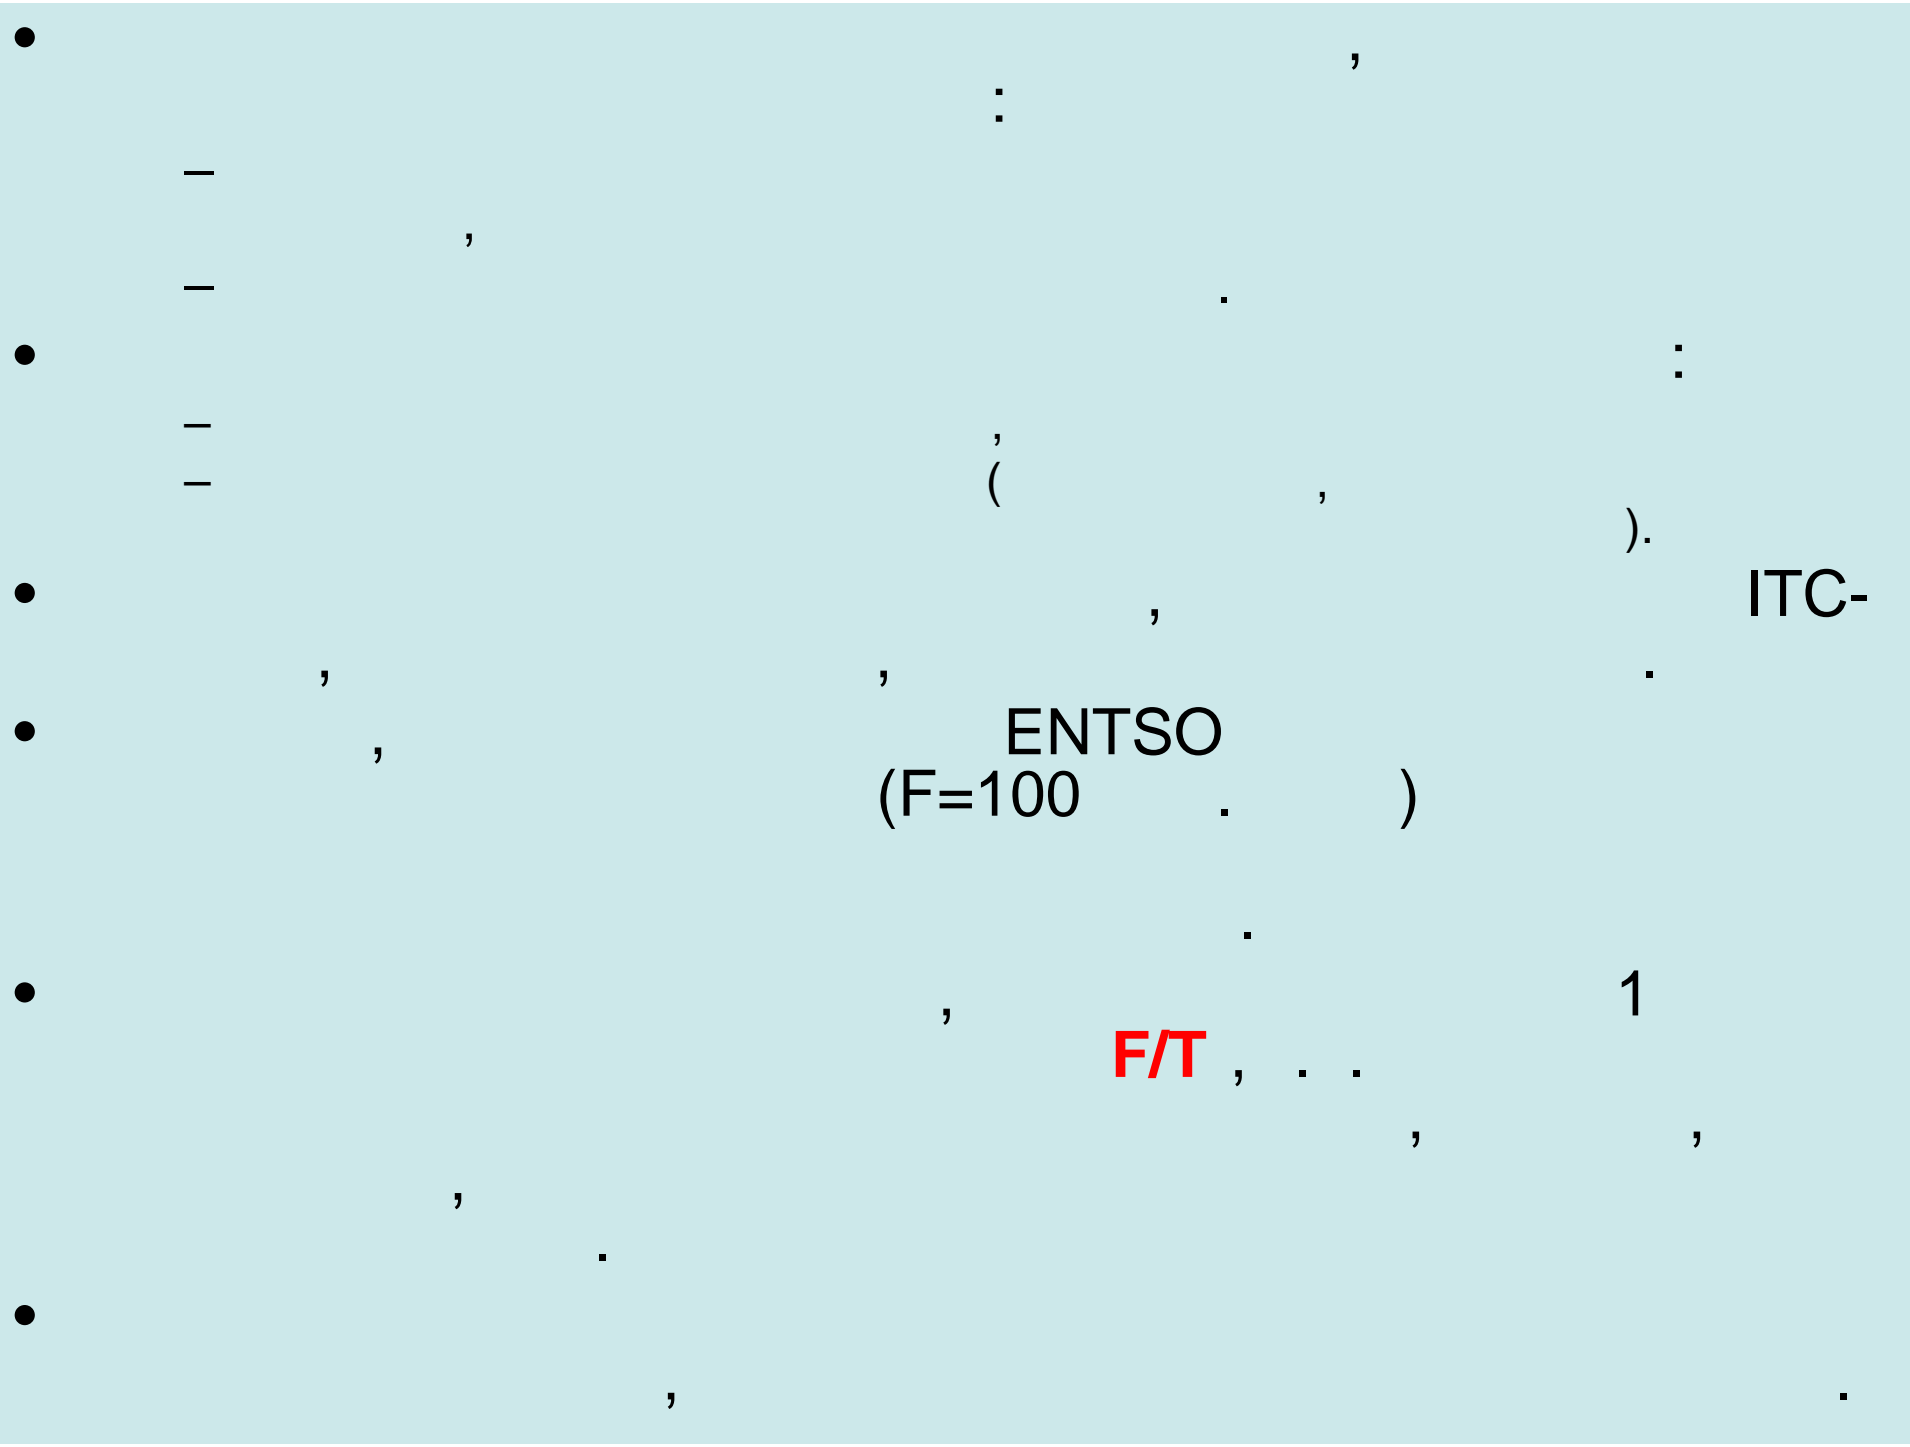

ENTSO  
(F=100)

ITC-

F/T

1

?

:

,

WWT

,

/

,

-

,

.

,

,

(

).

,

,

,

,

.

,

(

)

-

,

,

(

)

.

,

,

,

.

,

"

"

ITC

.

,

,

,

,

.

(LF - load factor),

ITC-

ETSO.

•

•

•

•

,

,

▪

,

,

,

:

:

,

▪

"

"

,

,

▪

2011

2003

CASA-1000

TUTAP,



•

•

«

,

».

•

,

,

,

•

•

•

•

,

•

•

,

,

•

•

,

•

